
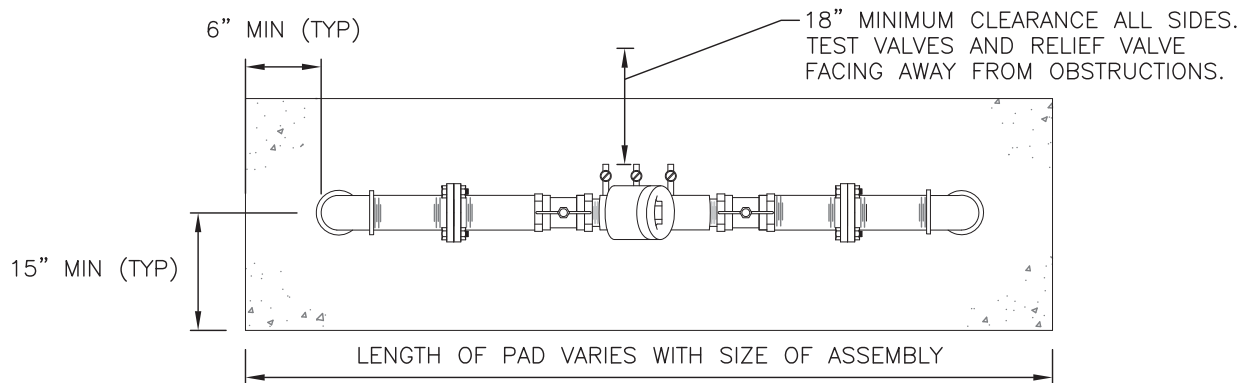
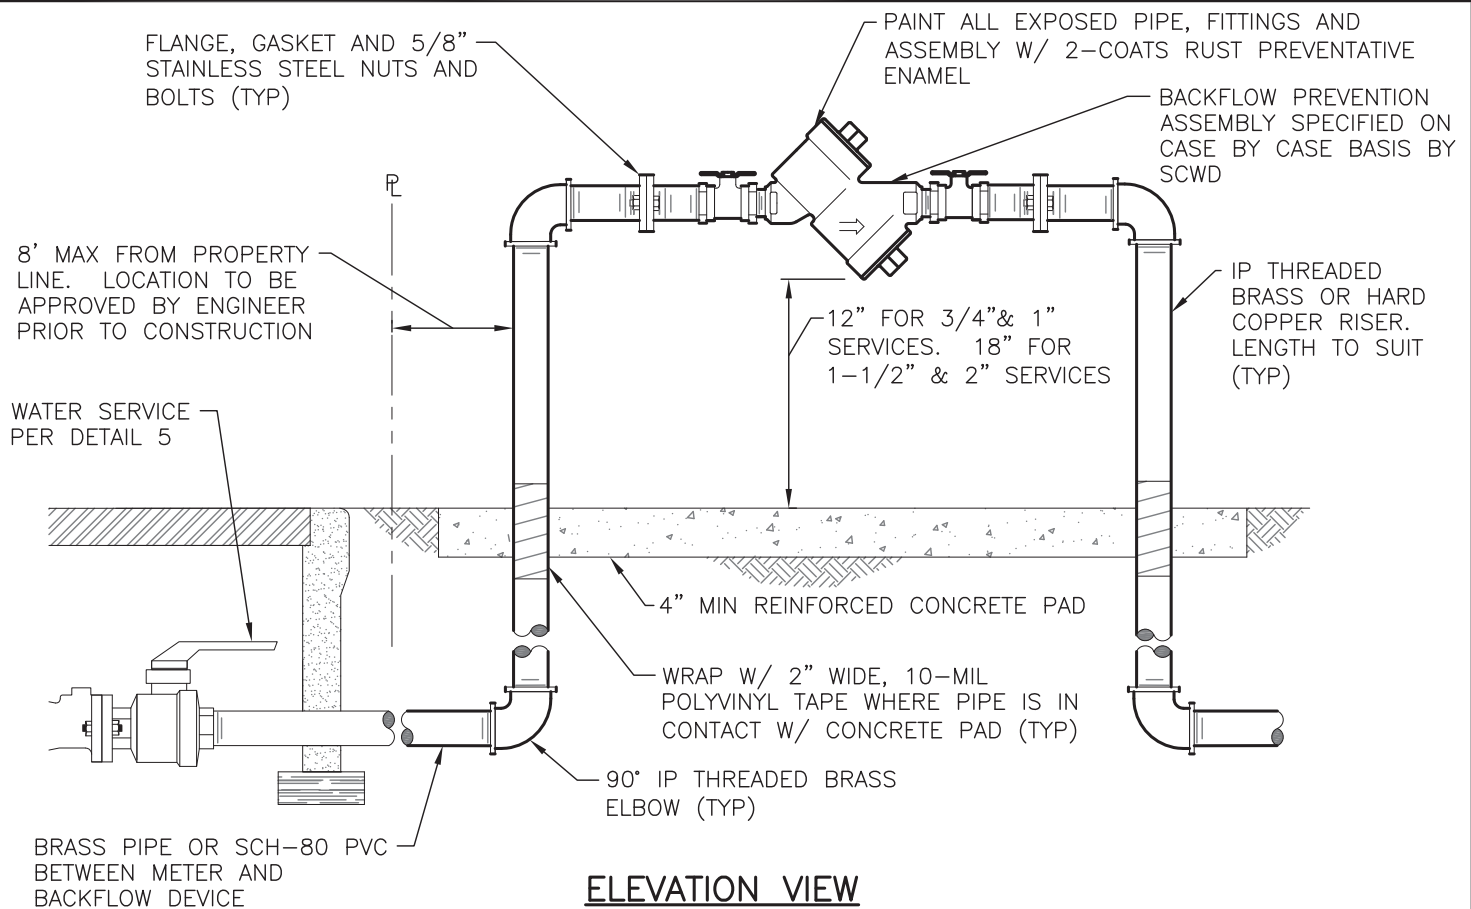




NOTES

1. APPROVED BACKFLOW ASSEMBLY SHALL BE INSTALLED SUCH THAT IT IS READILY ACCESSIBLE FOR REPAIR AND INSPECTION.
2. BRASS FITTINGS, VALVES AND PIPE SHALL CONSIST OF LOW-LEAD BRASS ALLOY AND SHALL HAVE A MINIMUM WORKING PRESSURE OF 150 PSI.
3. BRASS OR PLASTIC PLUGS SHALL BE INSTALLED ON ALL TEST PORTS.
4. ALL ABOVE GROUND PIPE, FITTINGS AND ASSEMBLY SHOULD BE PAINTED WITH TWO COATS OF ENAMEL.
5. AN ENCLOSURE OR CAGE MAY BE INSTALLED AT THE OPTION OF THE PROPERTY OWNER.

	WATER DEPARTMENT
	CITY OF SANTA CRUZ, CALIFORNIA
	DETAIL 8
	2-INCH AND SMALLER BACKFLOW PREVENTION ASSEMBLY INSTALLATION
NOT TO SCALE	
APPROVED 	RCE 37391